

CERTIFICATE OF EMC

CERTIFICATE NO.: SET2015-01566

Product: Group control board

Model: BL2000-QKB-V* (*=2-2.99, indicate the different customer or/and Software function number)

Applicant: ShenYang Bluelight Automatic Technology Co., Ltd.

Address: No. 37 Shiji Road, Hunnan New District, Shenyang, China

This is to certify that, on the basis of tests undertaken as per Report No. SET2015-01566 the submitted sample of the above item complies with:

EN61000-6-4:2007+A1:2011

EN61000-6-2:2005

and fulfils testing requirements of EMC directive 2004/108/EC



Signed for and on behalf of
CCIC Southern Electronic Product Testing (Shenzhen) Co., Ltd.

Wu Li An

Wu Li An, Vice Director

Date of Issue: Feb. 06, 2015

CCIC Southern Electronic Product Testing (Shenzhen) Co., Ltd.
Building 28/29, Shiguan Industrial Area, 10th Street, Nanshan District,
Shenzhen, Guangdong, China
Tel: 86-755-26627338 Fax: 86-755-26627238 <http://www.ccic-set.com>





Report No.

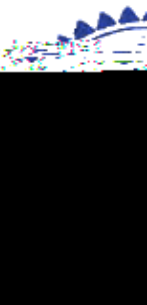




Table of Contents

Report.....	2
1 General Information.....	5
1.1 Description of EUT.....	5
1.2 Objective.....	5
2 Test Facilities and Configuration.....	5
2.1 Environmental Conditions.....	5
2.2 Measurement Uncertainty.....	5
2.3 Test Standards and Results.....	6
2.4 List of Equipments Used.....	7
3 Emission Test.....	8
3.1 EUT Setup and Operating Conditions.....	8
3.2 Radiated Disturbance Measurement.....	8
3.2.1 Limits of Radiated Disturbance.....	8
3.2.2 Test Setup.....	8
3.2.3 Test Result.....	9
4 Immunity Test.....	11
4.1 EUT Setup and Operating Conditions.....	11
4.2 Performance Criteria.....	11
4.3 Electrostatic Discharge Immunity Test.....	11
4.3.1 Test Specification.....	11
4.3.2 Test Setup.....	12
4.3.3 Test Result.....	12
4.4 Radiated, Radio Frequency Electromagnetic Field Immunity Test.....	13
4.4.1 Test Specification.....	13
4.4.2 Test Setup.....	13
4.4.3 Test Result.....	14



4.5 Electrical Fast Transient/Burst Immunity Test.....	14
4.5.1 Test Specification	14
4.5.2 Test Setup	14
4.5.3 Test Result	15
4.6 Surge Immunity Test	15
4.6.1 Test Specification	15
4.6.2 Test Setup	15
4.6.3 Test Result	15
4.7 Immunity to Conducted Disturbances Induced by RF Fields	16
4.7.1 Test Specification	16
4.7.2 Test Setup	16
4.7.3 Test Result	16
4.8 Power Frequency Magnetic Field Immunity Test	17
4.8.1 Test Specification	17
4.8.2 Test Setup	17
4.8.3 Test Result	17
Appendix I Photographs of the EUT.....	18
Appendix II Photographs of EMC Test Configuration	19

1 General Information

1.1 Description of EUT

Product: Group control board
Model No.: BL2000-QKB-V2
Brand Name: /
Serial No.: /
Rating: Input: 5V DC
Accessories: /

NOTE:

1. For more detailed features description about the EUT, please refer to User's Manual.
2. Application model is BL2000-QKB-V* (*=2-2.99, indicate the different customer or/and Software function number). Models differences do not affect the performance of EMC. All tests were performed on Model BL2000-QKB-V2 and results represented other models.
3. The highest frequency of the internal source of the EUT is below 108 MHz, so the radiated emission measurement shall be made up to 1GHz.

1.2 Objective

Perform ElectroMagnetic Interference (EMI) and ElectroMagnetic Susceptibility (EMS) tests for CE Marking.

2 Test Facilities and Configuration

2.1 Environmental Conditions

During the measurement the environmental conditions were within the listed ranges:

- Temperature: 15-35°C
- Humidity: 30-60 %
- Atmospheric pressure: 86-106 kPa

2.2 Measurement Uncertainty

The uncertainty is calculated using the methods suggested in the "Guide to the Expression of Uncertainty in Measurement" (GUM) published by ISO.



2.3 Test Standards and Results

The EUT has been tested according to the following specifications:

EMISSION		
Standard	Test Type	Result
EN61000-6-4:2007+A1:2011	Radiated disturbance	PASS
IMMUNITY (EN61000-6-2:2005)		
Basic Standard	Test Type	Result
IEC 61000-4-2	Electrostatic discharge immunity	PASS
IEC 61000-4-3	Radiated, radio frequency electromagnetic field immunity	PASS
IEC 61000-4-4	Electrical fast transient/burst immunity	PASS
IEC 61000-4-5	Surge immunity	PASS
IEC 61000-4-6	Immunity to conducted disturbances induced by RF fields	PASS
IEC 61000-4-8	Power frequency magnetic field immunity	PASS



2.4 List of Equipments Used

Description	Manufacturer	Model No.	Calibration Date	Serial No.
Test Receiver	ROHDE&SCHWARZ	ESCI	Jun.10, 2015	A0902601
Broadband Ant. Anechoic Broadba5	ROHDE&SCHWARZ	VULB 09160	Jun.10, 2015	A0805560



3 Emission Test


3.1 EUT Setup and Operating Conditions

The EUT was powered by 5V DC mains. The EUT was continuously operated during the test.


3.2 Radiated Disturbance Measurement

3.2.1 Limits of Radiated Disturbance


Frequency range (MHz)	Quasi peak limits(dB V/m), at 10m measurement distance
30 – 230	40
230 - 1000	47

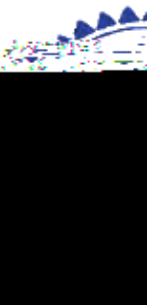

1. Electromagnetic radiation disturbances, max peak detector, antenna polarization: Vertical

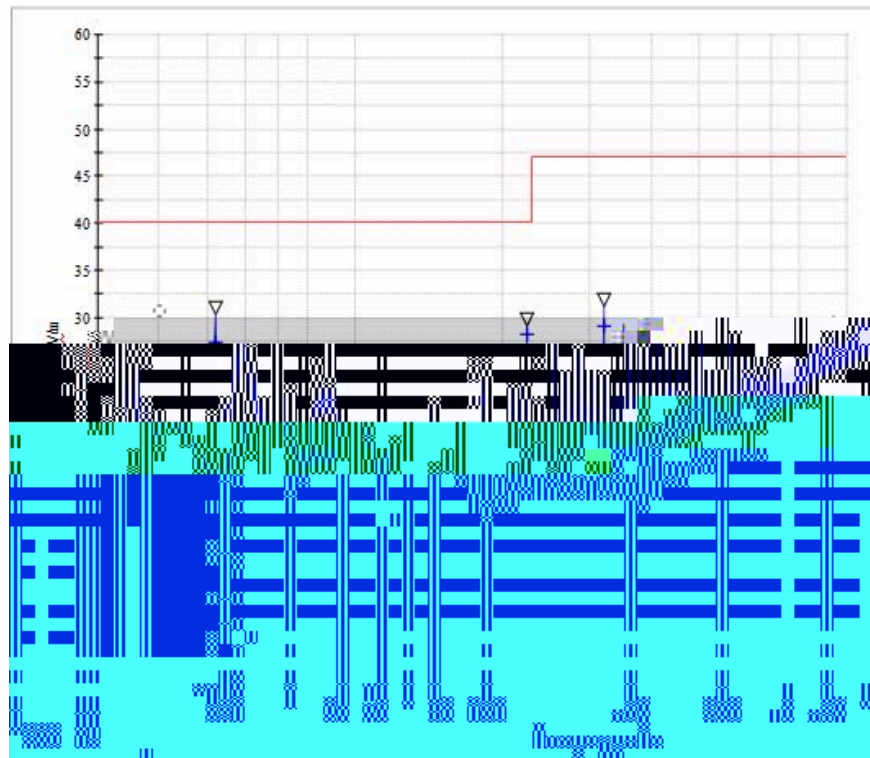

2. Electromagnetic radiation disturbances, max peak detector, antenna polarization: Horizontal

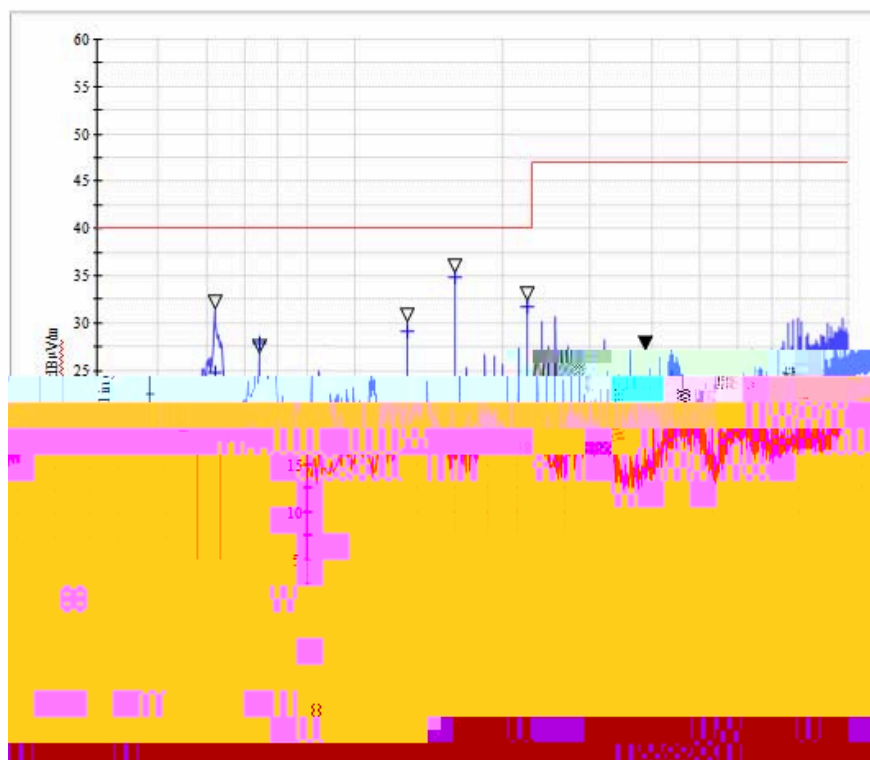

4 Immunity Test

4.1 EUT Setup and Operating Conditions

Same as 3.1.

4.2 Performance Criteria

Criterion A	The apparatus shall continue to operate as intended. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended.
Criterion B	The apparatus shall continue to operate as intended after the test. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer, when the apparatus is used as intended.
Criterion C	Temporary loss of function is allowed, provided the function is self-recoverable or can be restored by the operation of the controls.


4.3 Electrostatic Discharge Immunity Test


4.3.1 Test Specification

Basic Standard:	IEC 61000-4-2
Discharge Impedance	330 / 150 pF
Discharge Voltage:	Air Discharge: 8 kV Contact Discharge: 4kV
Polarity:	Positive / Negative
Number of Discharge:	Minimum 20 times at each test point
Discharge Mode:	Single discharge
Discharge Period:	1-second minimum
Criterion:	B



Report No. SET2015-01566

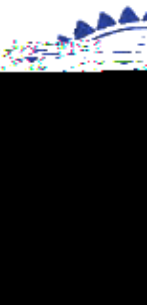



4.4.3 Test Result

Frequency	Polarity	Azimuth	Field Strength (V/m)	Observation	Comply with Criterion
80-1000 MHz	V&H	0,90, 80, 270	10	Note(1)	A
1.4-2.0GHz	V&H	0,90, 80, 270	3	Note(1)	A
2.0-2.7GHz	V&H	0,90, 80, 270	1	Note(1)	A

NOTE:

(1). The EUT continued to operate as intended. No degradation of performance was observed.


4.5 Electrical Fast Transient/Burst Immunity Test

4.5.1 Test Specification

Basic Standard: IEC 61000-4-4



Report No. SET2015-01566

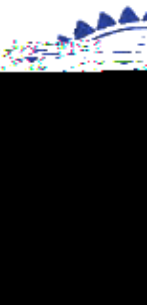



4.7 Immunity to Conducted Disturbances Induced by RF Fields

4.7.1 Test Specification

Basic Standard:	IEC 61000-4-6
------------------------	---------------

4.8 Power Frequency Magnetic Field Immunity Test

4.8.1 Test Specification


Basic Standard:	IEC 61000-4-8
Frequency Range:	50Hz

Appendix I Photographs of the EUT



Appendix II Photographs of EMC Test Configuration


1. Radiated Field Strength Measurement

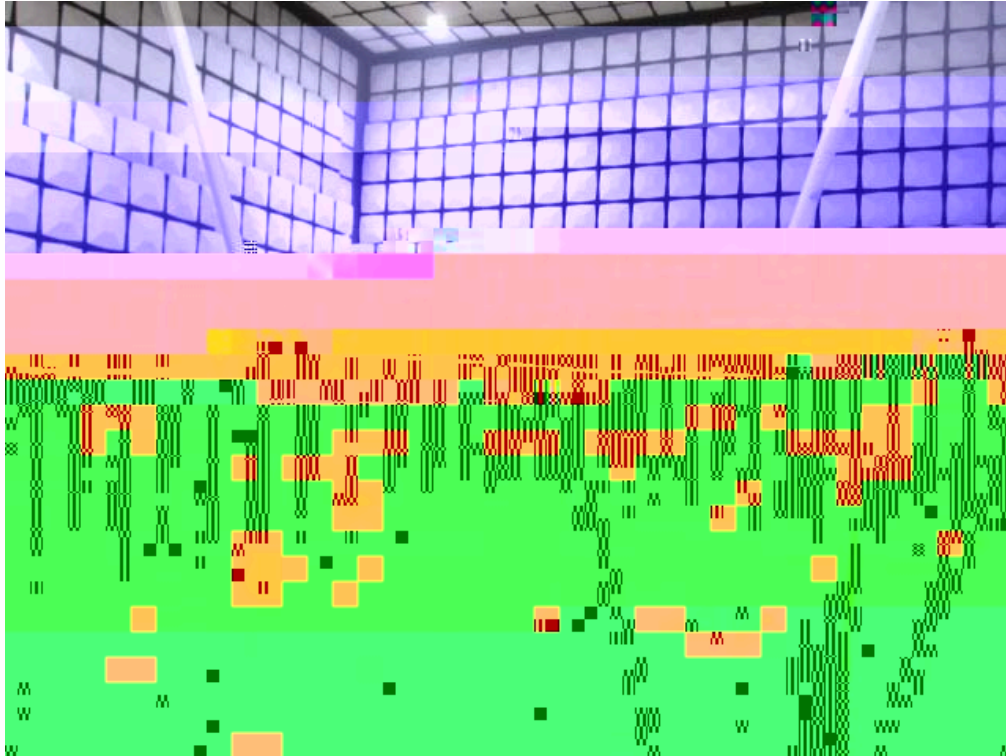


2. Electrostatic Discharge Immunity Test




3. Radiated, Radio Frequency Electromagnetic Field Immunity Test (below 1GHz)

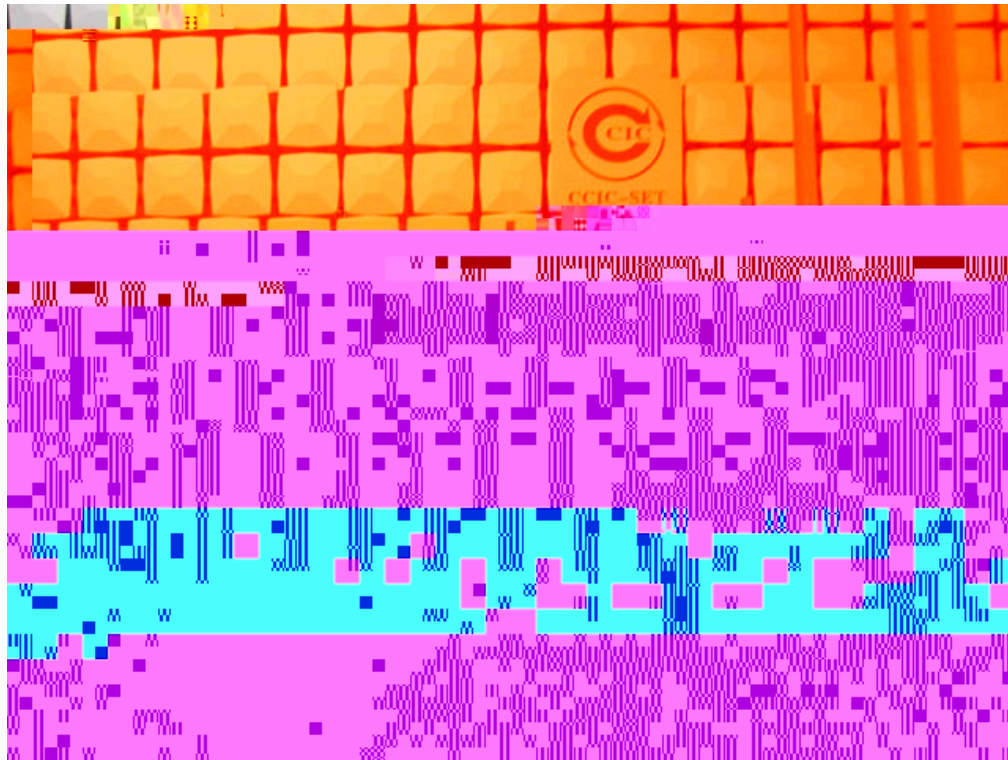


4. Radiated, Radio Frequency Electromagnetic Field Immunity Test (above 1GHz)

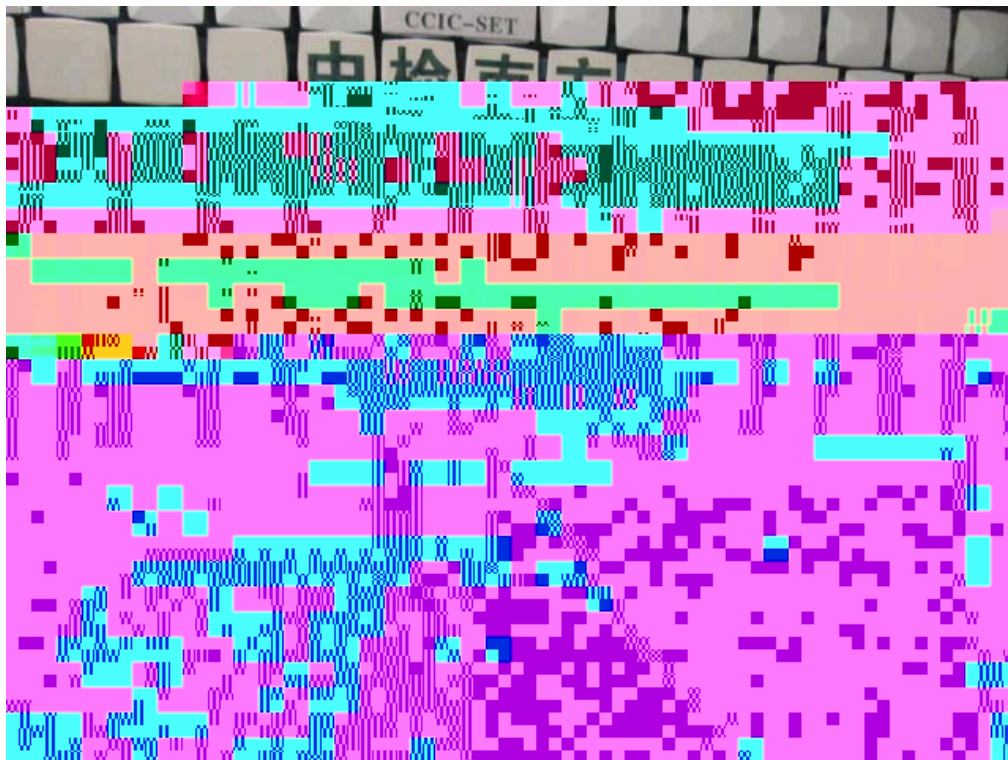

5. Electrical Fast Transient/Burst Immunity Test

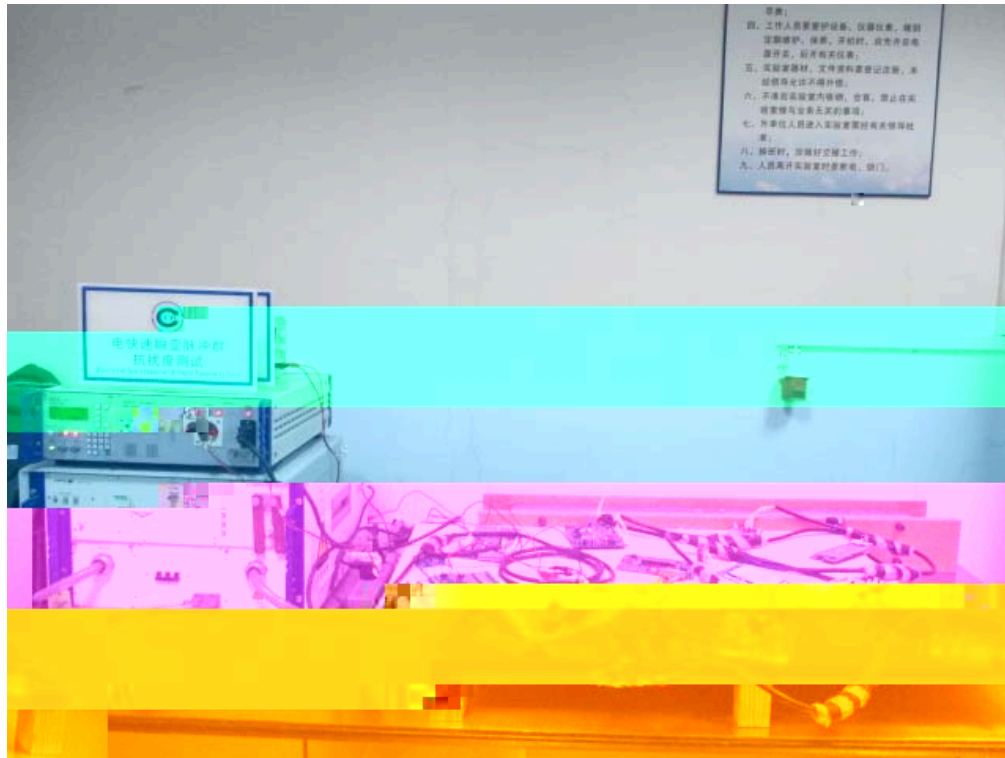

6. Surge Immunity Test

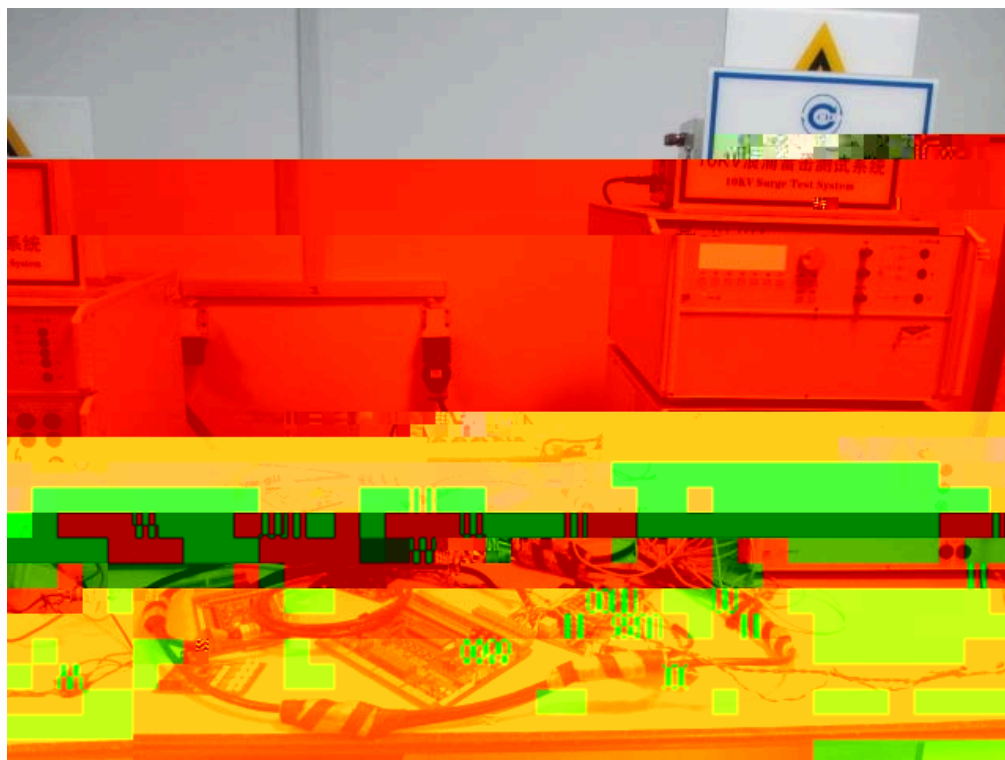

7. Immunity to Conducted Disturbances Induced by RF Fields

8. Power Frequency magnetic Field Immunity



STATEMENT

1. **This test laboratory is accredited by CNAS, Accreditation Certificate No.L1659.**
2. **The test report is invalid without stamp of laboratory.**
3. **The test report is invalid without signature of person(s) testing and authorizing.**
4. **The test report is invalid if erased and corrected.**
5. **Test results of the report is valid to the test samples if sampling by client.**
6. " " item cannot be Accredited by CNAS.
7. **The test report shall not be reproduced except in full, without written approval of the laboratory.**
8. **If there is any objection to report, the client should inform issuing laboratory within 15 days from the date of receiving test report.**

Address: Building 28/29, Shigudong, Xili Industrial Area, Xili Street, Nanshan District, Shenzhen, Guangdong, China
P.C. 518055

TEL 0755-26628093 26627338

FAX 0755-26627238

Internet <http://www.ccic-set.com>

E-Mail manager@ccic-set.com