
..... 1

..... 3

..... 4

..... 7

.....






- ◆
- ◆
- ◆
- ◆
- ◆

--


--


— — —


--	--	--	--	--	--

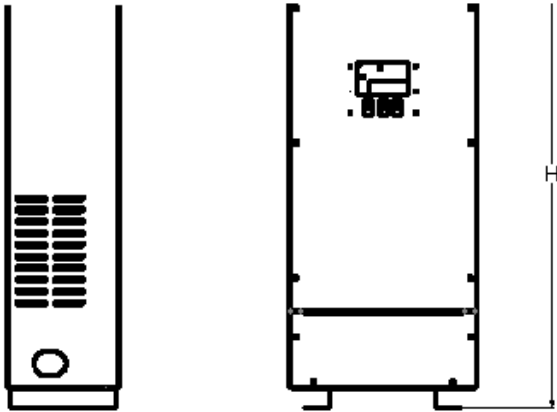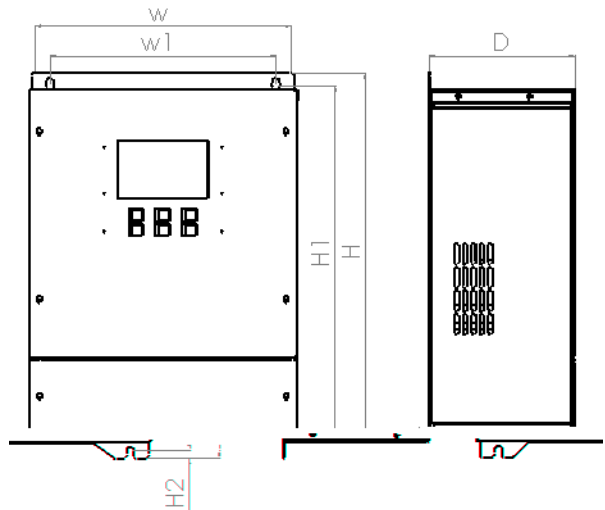





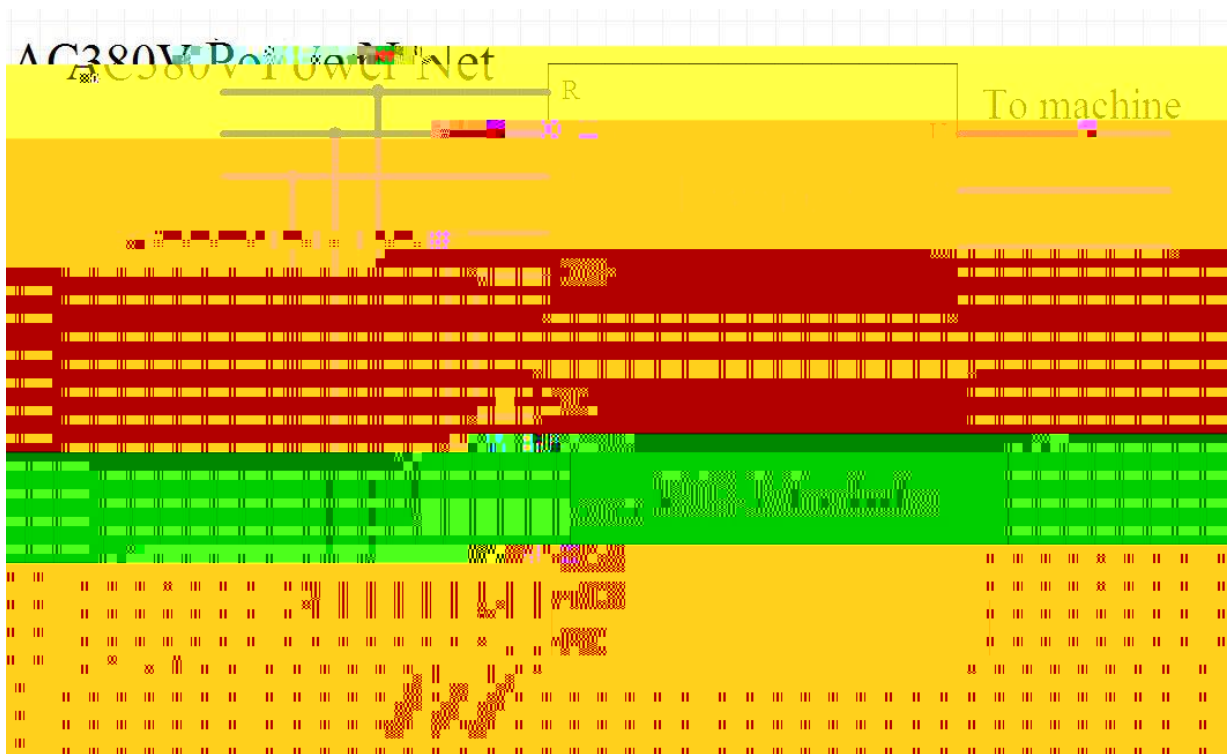

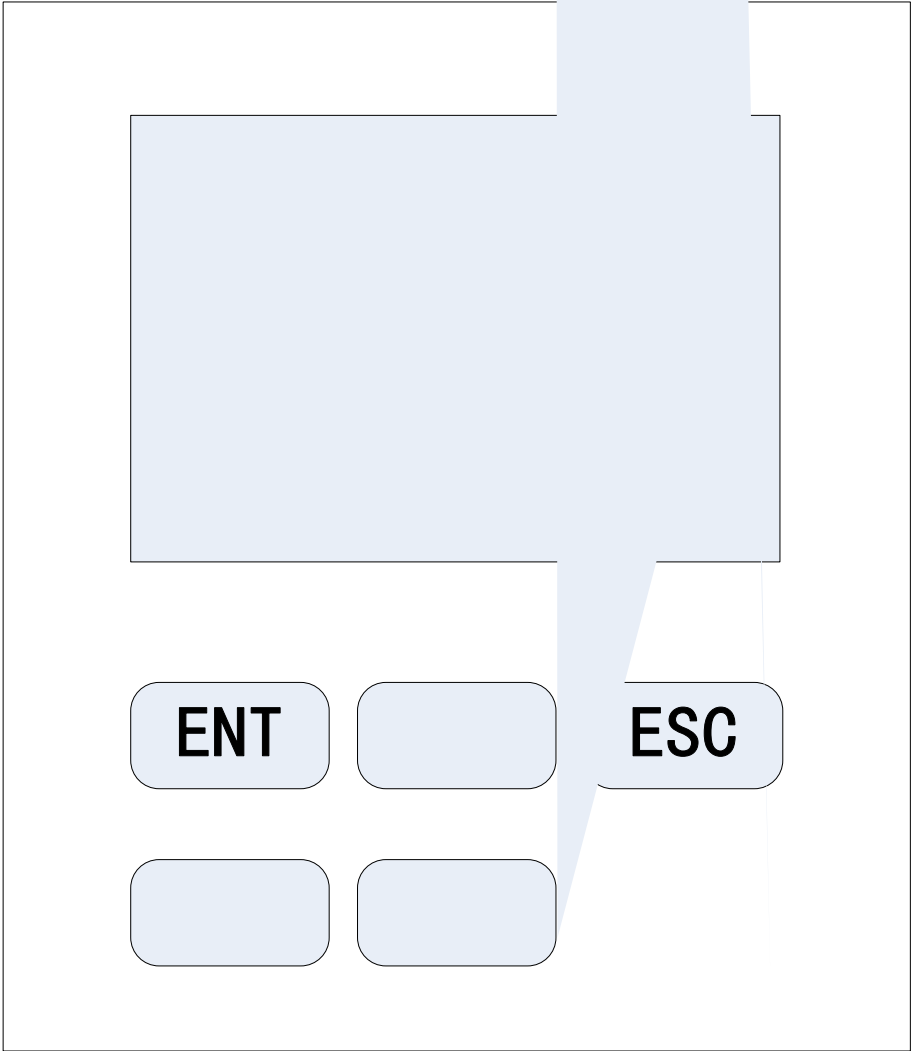ENT		
ESC		
▲		
▼		
◀		
▸		

Energy Feedback Unit	
Current Status	Status: Normal
Inverter Bus Voltage	Voltage: 000V
Feedback Current	Current: 00.0A
Current time	Time: 03:00
Total Feedback Energy	FB Energy: 000.00KWH

